

**ADDENDUM NO 1
TO
CONTRACT DOCUMENTS
FOR
FINISHED WATER PUMP VAULT VENTILATION

DISTRICT PROJECT NO. 4371

7/9/2026**


This addendum is hereby attached to and made part of the Contract Documents. The addendum consists of 2 pages of written text (including this cover sheet) and 9 pages of drawings. Each Bidder shall acknowledge receipt of this addendum on the bid (page C-1) and by signing and attaching this addendum to the bid.

1. Bidding document pages M2, E1, and E2 contain slight changes listed below.
2. A. Fan and vent piping may be square cut at the ends rather than cut at a 45°. B. Lighting for the vault should include 4 wall mounted light fixtures 84" above finished floor rather than 3 ceiling mounted light fixtures.

BID DATE AND TIME

The bid date and time remain unchanged as 7/24/2026

JORDAN VALLEY WATER CONSERVANCY DISTRICT

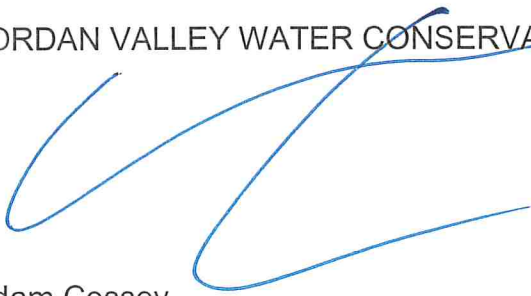

Adam Cossey
Staff Engineer

BIDDER’S CERTIFICATE


I acknowledge receipt of the foregoing Addendum No. 1 and accept all conditions contained therein.


Bidder:_____

By:_____

Signature

Date:_____

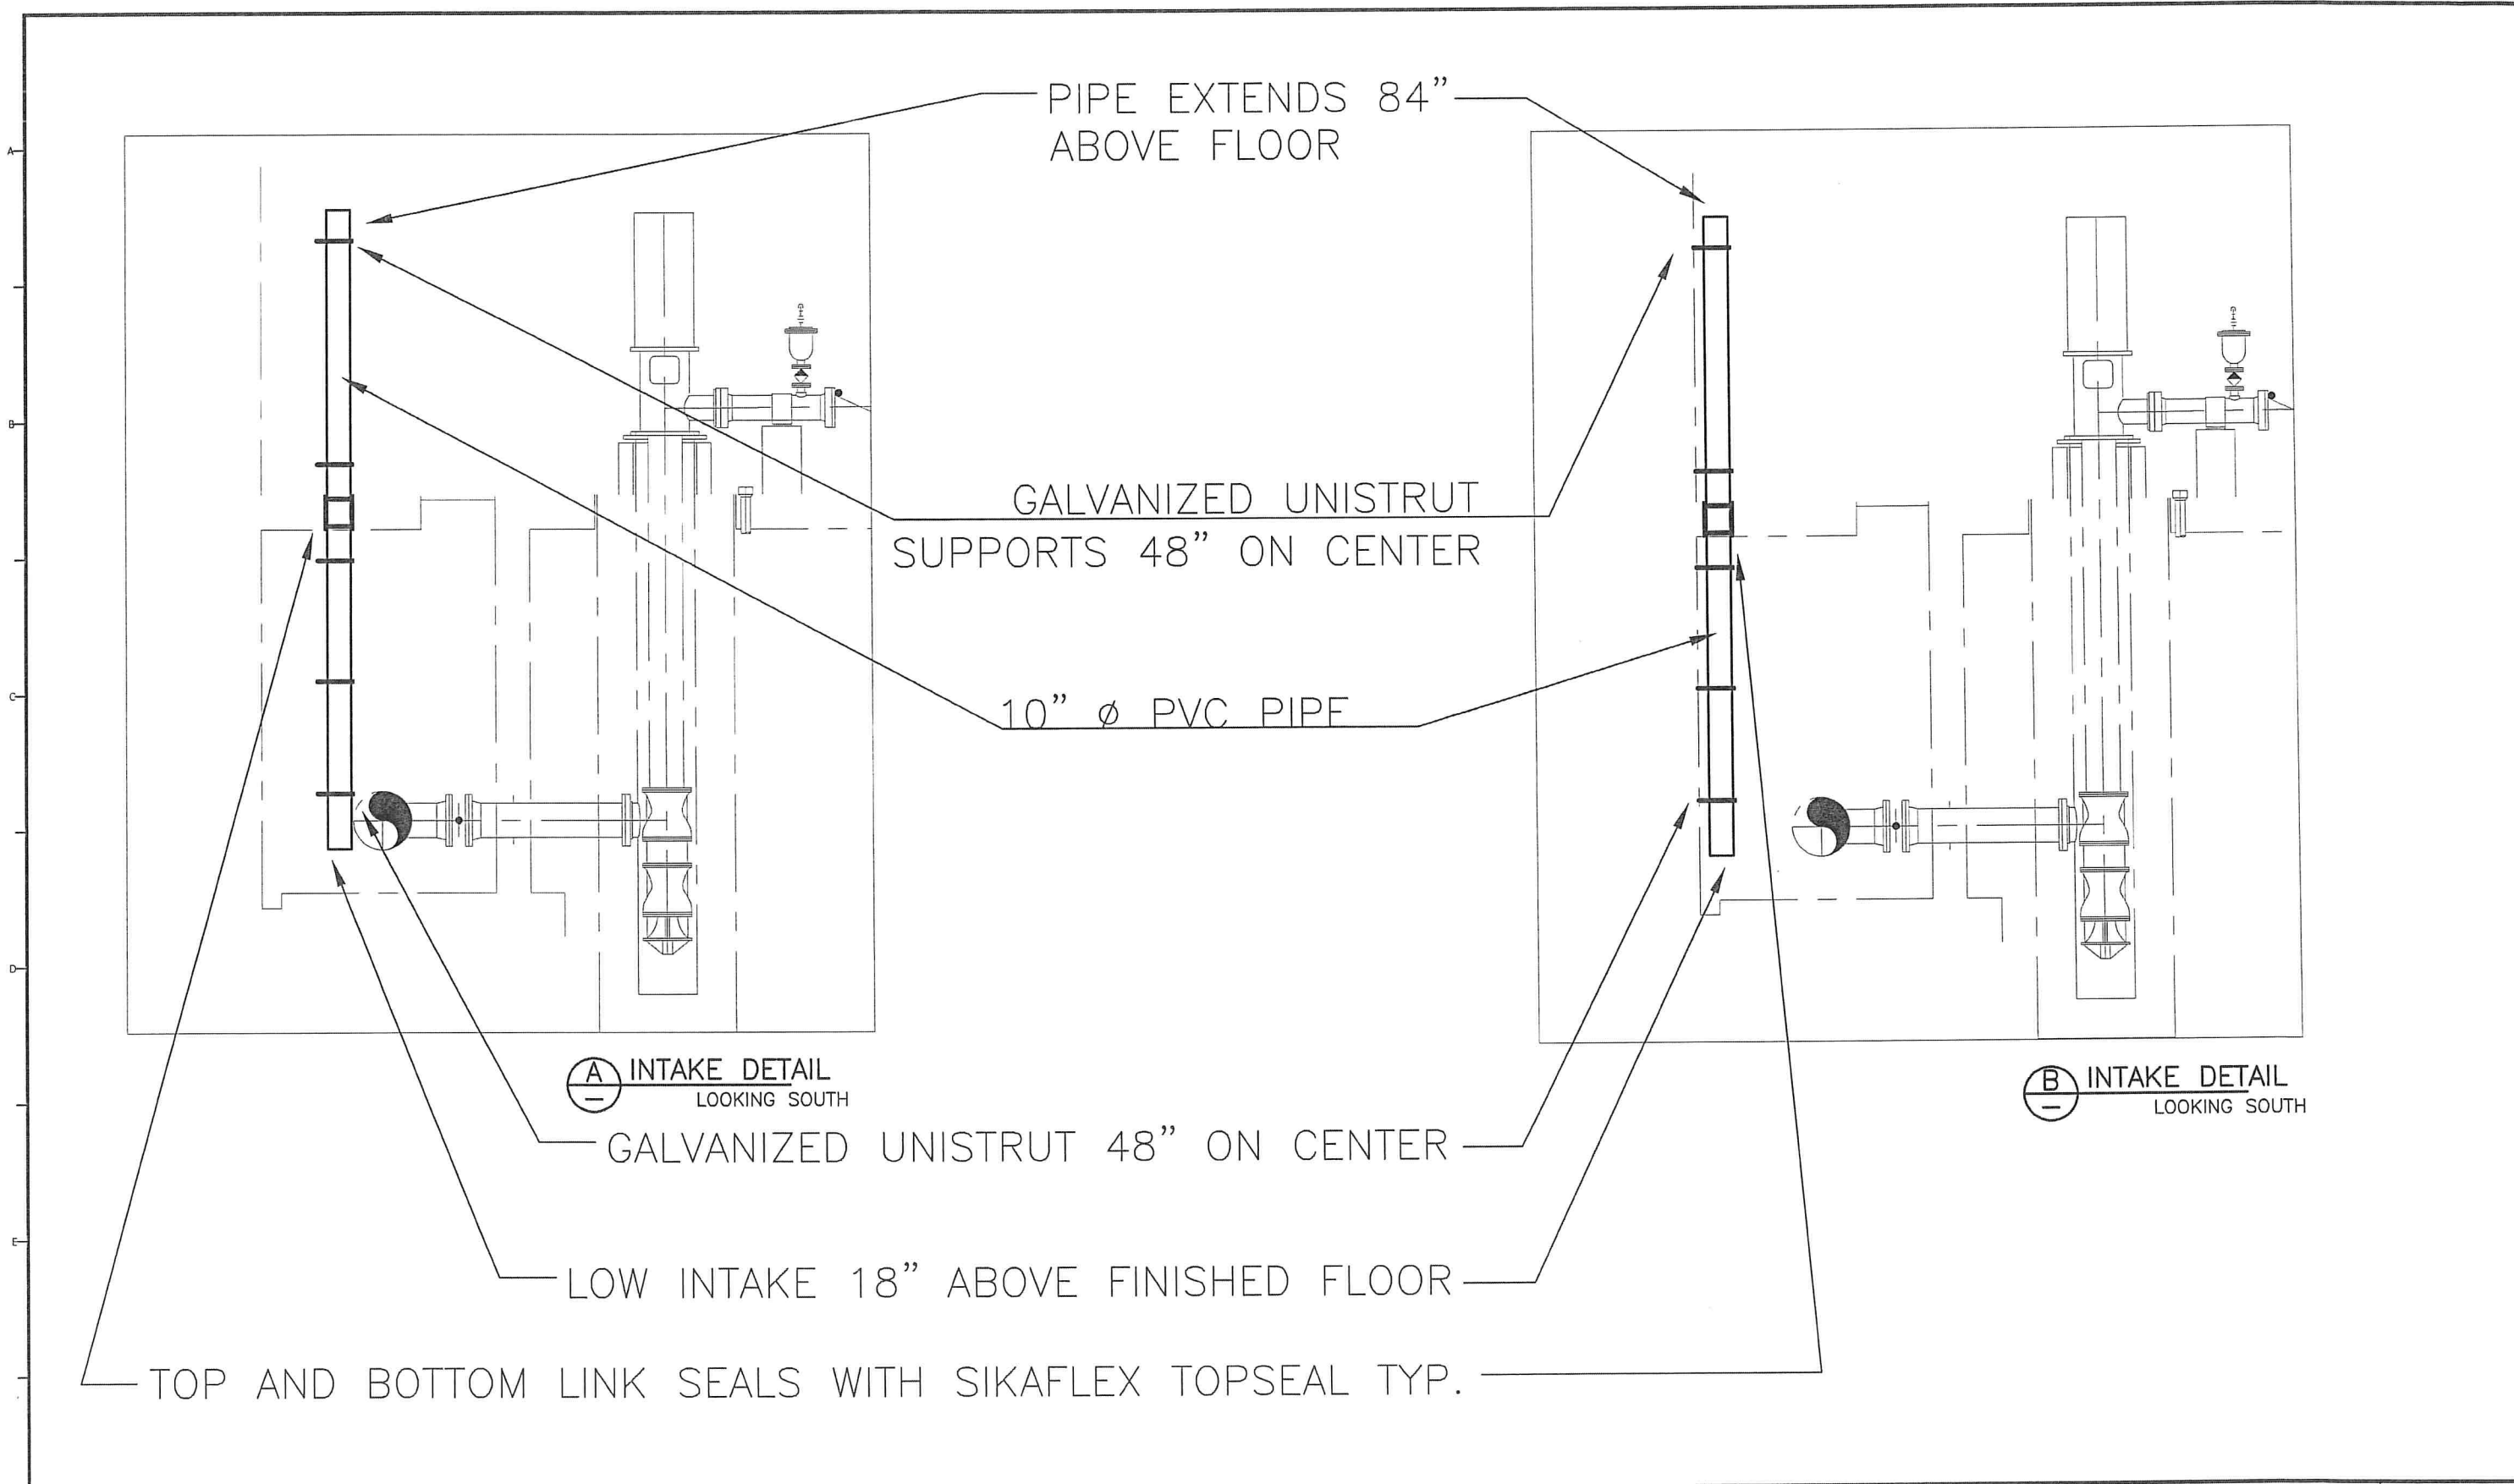




0 2' 4' 6'

NOTES:


1. UNLESS NOTED OTHERWISE, FURNISH AND INSTALL ALL PARTS SHOWN AS PART OF BID SCHEDULE A.

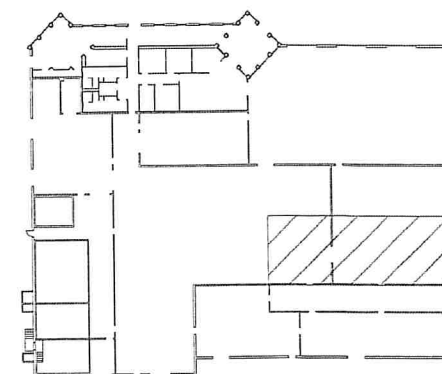


RO BUILDING
KEY PLAN

NOTES:


1. NEW WORK SHOWN BOLD ON REFERENCE BACKGROUND
2. PULL 120 VAC POWER FROM LP-111, CIRCUIT 33 (EXISTING SPARE BREAKER) TO VCP-2690
3. USE RIGID CONDUIT SIZED ACCORDING TO NEED
4. USE EXISTING EMPTY CONDUIT FROM LP-111 TO VCP-2690
5. CONTRACTOR SHALL SUBMIT FINAL CONDUIT PLAN FOR REVIEW
6. INSTALL LIGHTING ON EAST WALL 84" ABOVE FINISHED FLOOR

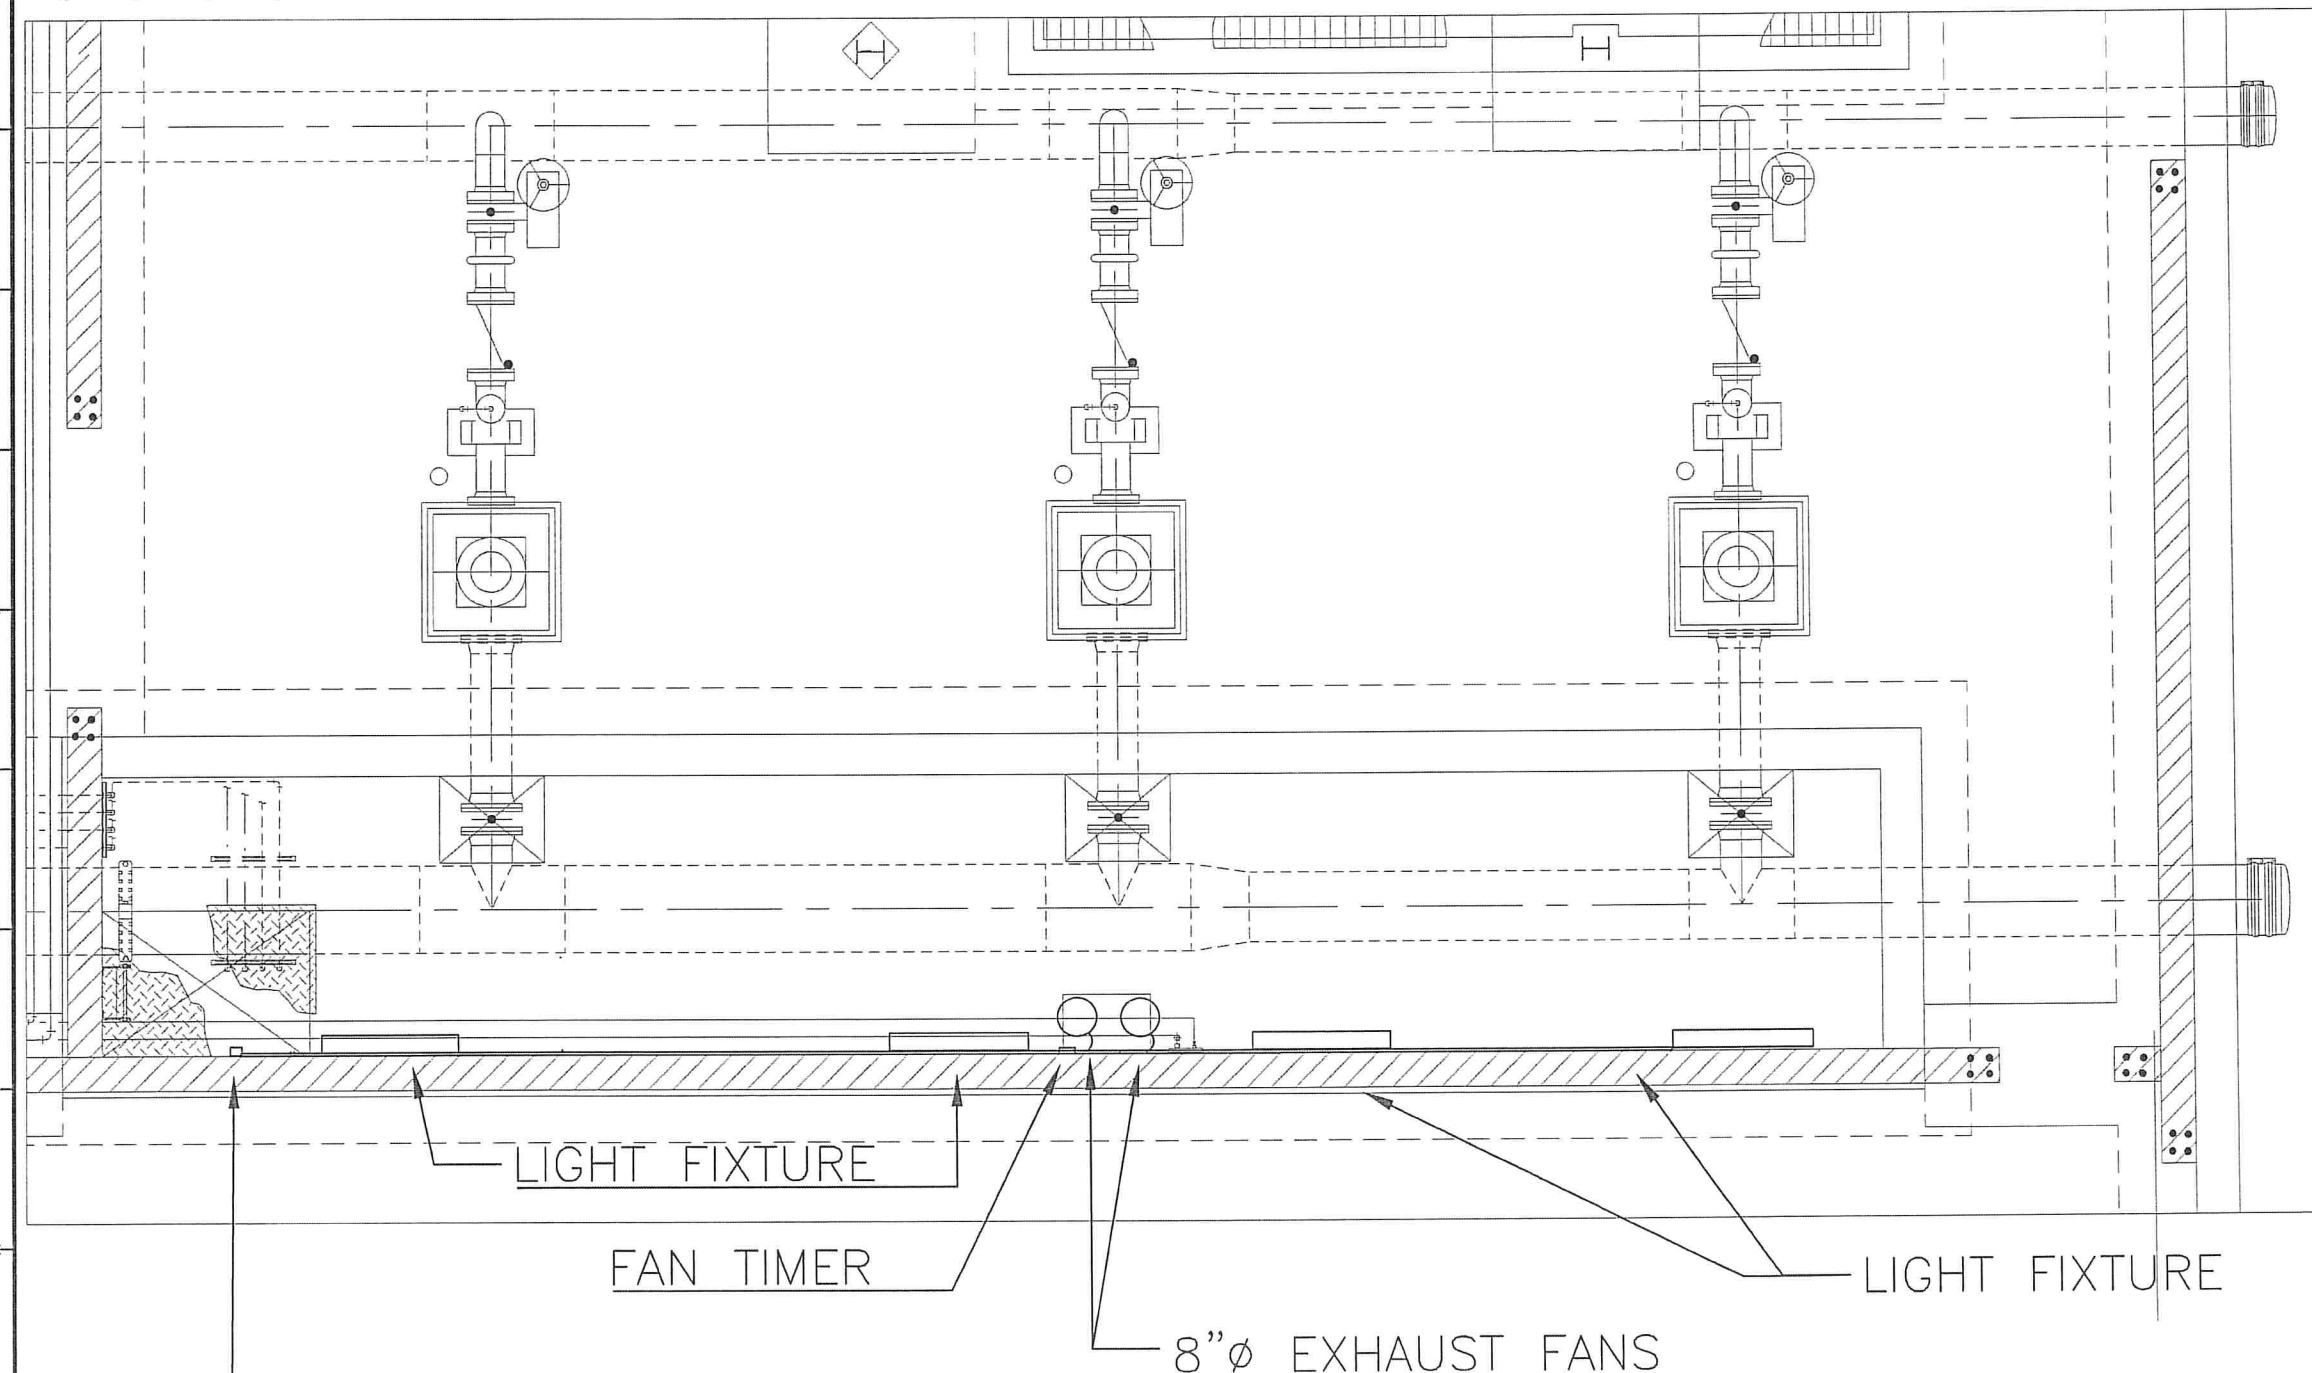

A FINISHED WATER PUMP AREA - PLAN
SCALE: 3/16" = 1'-0"
FILE: 02-M-24



REV.	REVISIONS		BY	DATE
	DESCRIPTION			



JORDAN VALLEY WATER
CONSERVANCY DISTRICT
8215 SOUTH 1300 WEST
WEST JORDAN, UTAH 84088-0070
PHONE (801) 565-4300

LINE IS 1/16" AT FULL SIZE (IF NOT 1" - SCALE ACCORDINGLY)		ORIGINAL SIZE B
SCALE: 3/16" = 1'		
DESIGN:	ABC	
DRAWING:	ABC	
PROJ. MGR:	Adam Cossey	
APPROVAL:		

FINISHED WATER PUMP VAULT VENTILATION

ELECTRICAL AND CONDUIT

DATE	6/10/2026
PROJECT NUMBER	4371
DRAWING NUMBER	E1
SHEET NUMBER	7 OF 9

C EXHAUST FAN DETAIL
SCALE: NTS

VENT 84" ABOVE FINISHED FLOOR

FAN TIMER


48" ABOVE
FINISHED FLOOR

CL ACCESS
HATCH


TO EXISTING 120 VAC POWER
SUPPLY LP-111 CIRCUIT 33
SPARE BREAKER (ASSUME 100'
PULL IN EXISTING CONDUIT)

HIGH EXHAUST FAN
12" BELOW CEILING

LOW EXHAUST FAN
18" ABOVE FINISHED FLOOR



REVISIONS			
REV.	DESCRIPTION	BY	DATE



JORDAN VALLEY WATER
CONSERVANCY DISTRICT
8215 South 1300 West
West Jordan, UT 84088
801-565-4300

LINE IS 1/8" INCH
AT FULL SIZE
(IF NOT 1" - SCALE ACCORDINGLY)

SCALE: NTS

DESIGN: ABC

DRAWING: ABC

PROJ. MGR: ADAM COSSEY

APPROVAL:

ORIGINAL
SIZE
B

FINISHED WATER PUMP AREA VENTILATION

EXHAUST FAN DETAILS

DATE
6/10/2026

PROJECT NUMBER
4371

DRAWING NUMBER
E2

SHEET NUMBER
8 OF 9